

[REDACTED]

From: Projectmail - National Grid [REDACTED]
Sent: 11 October 2019 10:16
To: Planning Policy
Subject: Nottinghamshire County Council: Minerals Local Plan Publication Version Consultation
Attachments: Nottinghamshire Local Plan Minerals and Waste REP 10.10.19.pdf

Dear Sir/Madam,

Please find the attached response on behalf of National Grid.

Kind regards

Wood on behalf of National Grid

Planning & Design| E&I UK
Wood Plc
Nicholls House, Homer Close, Leamington Spa, CV34 6TT
[REDACTED]

This message is the property of John Wood Group PLC and/or its subsidiaries and/or affiliates and is intended only for the named recipient(s). Its contents (including any attachments) may be confidential, legally privileged or otherwise protected from disclosure by law. Unauthorized use, copying, distribution or disclosure of any of it may be unlawful and is strictly prohibited. We assume no responsibility to persons other than the intended named recipient(s) and do not accept liability for any errors or omissions which are a result of email transmission. If you have received this message in error, please notify us immediately by reply email to the sender and confirm that the original message and any attachments and copies have been destroyed and deleted from your system.

If you do not wish to receive future unsolicited commercial electronic messages from us, please forward this email to: unsubscribe@woodplc.com and include "Unsubscribe" in the subject line. If applicable, you will continue to receive invoices, project communications and similar factual, non-commercial electronic communications.

Please click <http://www.woodplc.com/email-disclaimer> for notices and company information in relation to emails originating in the UK, Italy or France.

As a recipient of an email from a John Wood Group Plc company, your contact information will be on our systems and we may hold other personal data about you such as identification information, CVs, financial information and information contained in correspondence. For more information on our privacy practices and your data protection rights, please see our privacy notice at <https://www.woodplc.com/policies/privacy-notice>

Planning Policy Team
Place Department
Nottinghamshire County Council
County Hall
West Bridgford
Nottingham
NG2 7QP

Lucy Bartley
Consultant Town Planner

Tel: [REDACTED]
n.grid@woodplc.com

Sent by email to:
planning.policy@nottscc.gov.uk

11 November 2019

Dear Sir / Madam

**Nottinghamshire County Council: Minerals Local Plan Publication Version Consultation
SUBMISSION ON BEHALF OF NATIONAL GRID**

National Grid has appointed Wood to review and respond to development plan consultations on its behalf. We are instructed by our client to submit the following representation with regard to the current consultation on the above document.

About National Grid

National Grid Electricity Transmission plc (NGET) owns and maintains the electricity transmission system in England and Wales and National Grid Electricity System Operator (NGESO) operates the electricity transmission network across the UK. The energy is then distributed to the eight electricity distribution network operators across England, Wales and Scotland.

National Grid Gas plc (NGG) owns and operates the high-pressure gas transmission system across the UK. In the UK, gas leaves the transmission system and enters the UK's four gas distribution networks where pressure is reduced for public use.

National Grid previously owned part of the gas distribution system known as 'National Grid Gas Distribution limited (NGGDL). Since May 2018, NGGDL is now a separate entity called 'Cadent Gas'.

To help ensure the continued safe operation of existing sites and equipment and to facilitate future infrastructure investment, National Grid wishes to be involved in the preparation, alteration and review of plans and strategies which may affect National Grid's assets.

Proposed sites crossed or in close proximity to National Grid infrastructure:

Following a review of the above development plan, the following sites have been identified as being crossed or in close proximity to National Grid infrastructure. Further details are provided in the table overleaf.

Electricity Transmission:

Site Ref	Asset Details	Appendix Ref
Sites MP2c Sturton le Steeple (Inset Map 4)	ZDA Route - 400Kv two circuit route from Keadby substation in North Lincolnshire to Cottam substation in Bassetlaw 4ZM Route – 400kv two circuit route from Bicker Fen substation in Boston to West Burton substation in Bassetlaw 4TM Route – 400kv two circuit route from West Burton substation in Bassetlaw to Keadby substation in North Lincolnshire 4VE Route – 400kv two circuit route from West Burton substation in Bassetlaw to Cottam substation in Bassetlaw	ET382
Site MP2g Girtton (Inset map 7)	4VK Route - 400kv two circuit route from Cottam substation in Bassetlaw to Eaton Socon substation in Bedford	ET258
Site MP2h Langford Lowfields (Inset map 8)	4VK Route - 400kv two circuit route from Cottam substation in Bassetlaw to Eaton Socon substation in Bedford	ET259
Site MP2f Besthorpe (Inset map 8)	4VK Route - 400kv two circuit route from Cottam substation in Bassetlaw to Eaton Socon substation in Bedford	ET383
Site MP2o Besthorpe East (Inset map 8)	4VK Route - 400kv two circuit route from Cottam substation in Bassetlaw to Eaton Socon substation in Bedford	ET383
Site DM6 South Mushkam (Inset map 9)	KK Route – 25kv single circuit route from Staythorpe substation in Newark and Sherwood to Newark substation in Newark and Sherwood ZDA Route – 400Kv two circuit route from Staythorpe substation in Newark and Sherwood to Cottam substation in Bassetlaw	ET260

Gas Transmission

Site Ref	Asset Details	Appendix Ref
Site MP7c Bantycok Quarry South Inset map 15	FM09 - Silk Willoughby to Staythorpe	GT87

Please see enclosed plan referenced ET382, ET258, ET259, ET283, ET260 & GT87 at Appendix 2. The proposed sites are crossed by a National Grid high voltage electricity transmission overhead line and National Grid underground high-pressure gas pipeline.

The statutory safety clearances between overhead lines, the ground, and built structures must not be infringed. Where changes are proposed to ground levels beneath an existing line then it is important that changes in ground levels do not result in safety clearances being infringed. National Grid can, on request, provide to developers detailed line profile drawings that detail the height of conductors, above ordnance datum, at a specific site. You can find National Grid's guidelines for developing near Over Head Lines here:

https://www.nationalgrid.com/sites/default/files/documents/Development%20near%20overhead%20lines_0.pdf

Electricity Distribution

Western Power Distribution owns and operates the local electricity distribution network in Nottinghamshire County Council. Contact details can be found at www.energynetworks.org.uk.

National Grid Asset Guidance

National Grid seeks to encourage high quality and well-planned development in the vicinity of its high voltage overhead lines. Land beneath and adjacent to the overhead line route should be used to make a positive contribution to the development of the site and can for example be used for nature conservation, open space, landscaping areas or used as a parking court. National Grid, in association with David Lock Associates has produced 'A Sense of Place' guidelines, which provide detail on how to develop near overhead lines and offers practical solutions which can assist in avoiding the unnecessary sterilisation of land in the vicinity of high voltage overhead lines.

Potential developers of these sites should be aware that it is National Grid policy to retain our existing overhead lines in-situ. The relocation of existing high voltage overhead lines will only be considered for projects of national importance which has been identified as such by central government.

National Grid requests that any High-Pressure Gas Pipelines are taken into account when site options are developed in more detail. These pipelines form an essential part of the national gas transmission system and National Grid's approach is always to seek to leave our existing transmission pipelines in situ. Please refer to the Health and Safety Executive (HSE) in the first instance.

National Grid have land rights for each asset which prevents the erection of permanent/ temporary buildings, or structures, changes to existing ground levels, storage of materials etc. Additionally, written permission will be required before any works commence within the National Grid easement strip, and a deed of consent is required for any crossing of the easement. In the first instance please consider checking with the Land Registry for the development area.

If you require any further information in relation to the above and/or if you would like to check if National Grid's transmission networks may be affected by your works, please contact National Grid's Plant Protection team via plantprotection@nationalgrid.com or visit the website: <https://www.linesearchbeforeudig.co.uk/>

Further Advice

National Grid is happy to provide advice and guidance to the Council concerning our networks. If we can be of any assistance to you in providing informal comments in confidence during your policy development, please do not hesitate to contact us. In addition, the following publications are available from the National Grid website or by contacting us at the address overleaf:

- A sense of place – design guidelines for development near high voltage overhead lines: A sense of place design guidelines for development near high voltage overhead lines: <https://www.nationalgridet.com/document/130626/download>
- Guidelines when working near NGG assets: <https://www.nationalgridgas.com/land-and-assets/working-near-our-assets>
- Guidelines when working near NGETT assets: <https://www.nationalgridet.com/network-and-assets/working-near-our-assets>

Appendices - National Grid Assets

Please find attached in:

- Appendix 1 provides a map of the National Grid network across the UK.
- Appendix 2 provides maps of the sites referenced above in relation to the affected National Grid Transmission assets outlined above.

Please remember to consult National Grid on any Development Plan Document (DPD) or site-specific proposals that could affect our infrastructure. We would be grateful if you could add our details shown below to your consultation database:

Lucy Bartley
Consultant Town Planner

n.grid@woodplc.com

Wood E&I Solutions UK Ltd
Nicholls House
Homer Close
Leamington Spa
Warwickshire
CV34 6TT

Spencer Jefferies
Development Liaison Officer, National Grid

box.landacquisitions@nationalgrid.com

National Grid House
Warwick Technology Park
Gallows Hill
Warwick
Warwickshire
CV34 6DA

I hope the above information is useful. If you require any further information, please do not hesitate to contact me.

Yours faithfully


[via email]

Lucy Bartley
Consultant Town Planner


cc. Spencer Jefferies, National Grid

APPENDIX 1: NATIONAL GRID'S UK NETWORK

Where we operate
Our UK network

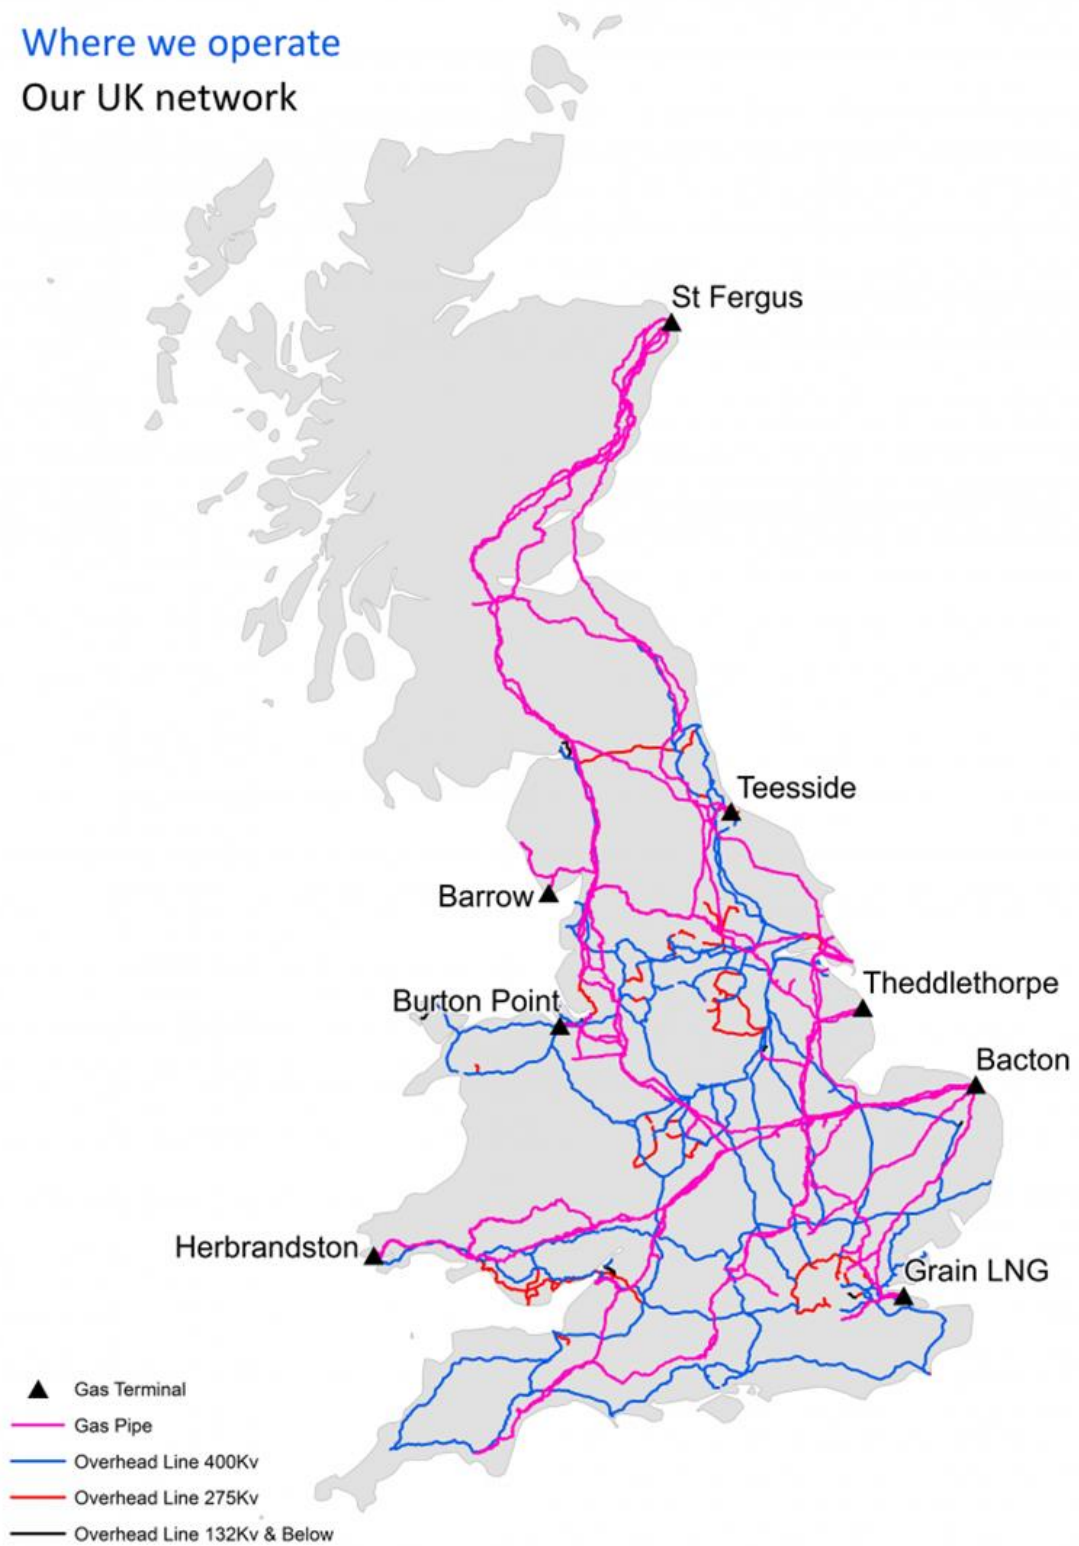

APPENDIX 2: NATIONAL GRID TRANSMISSION ASSETS

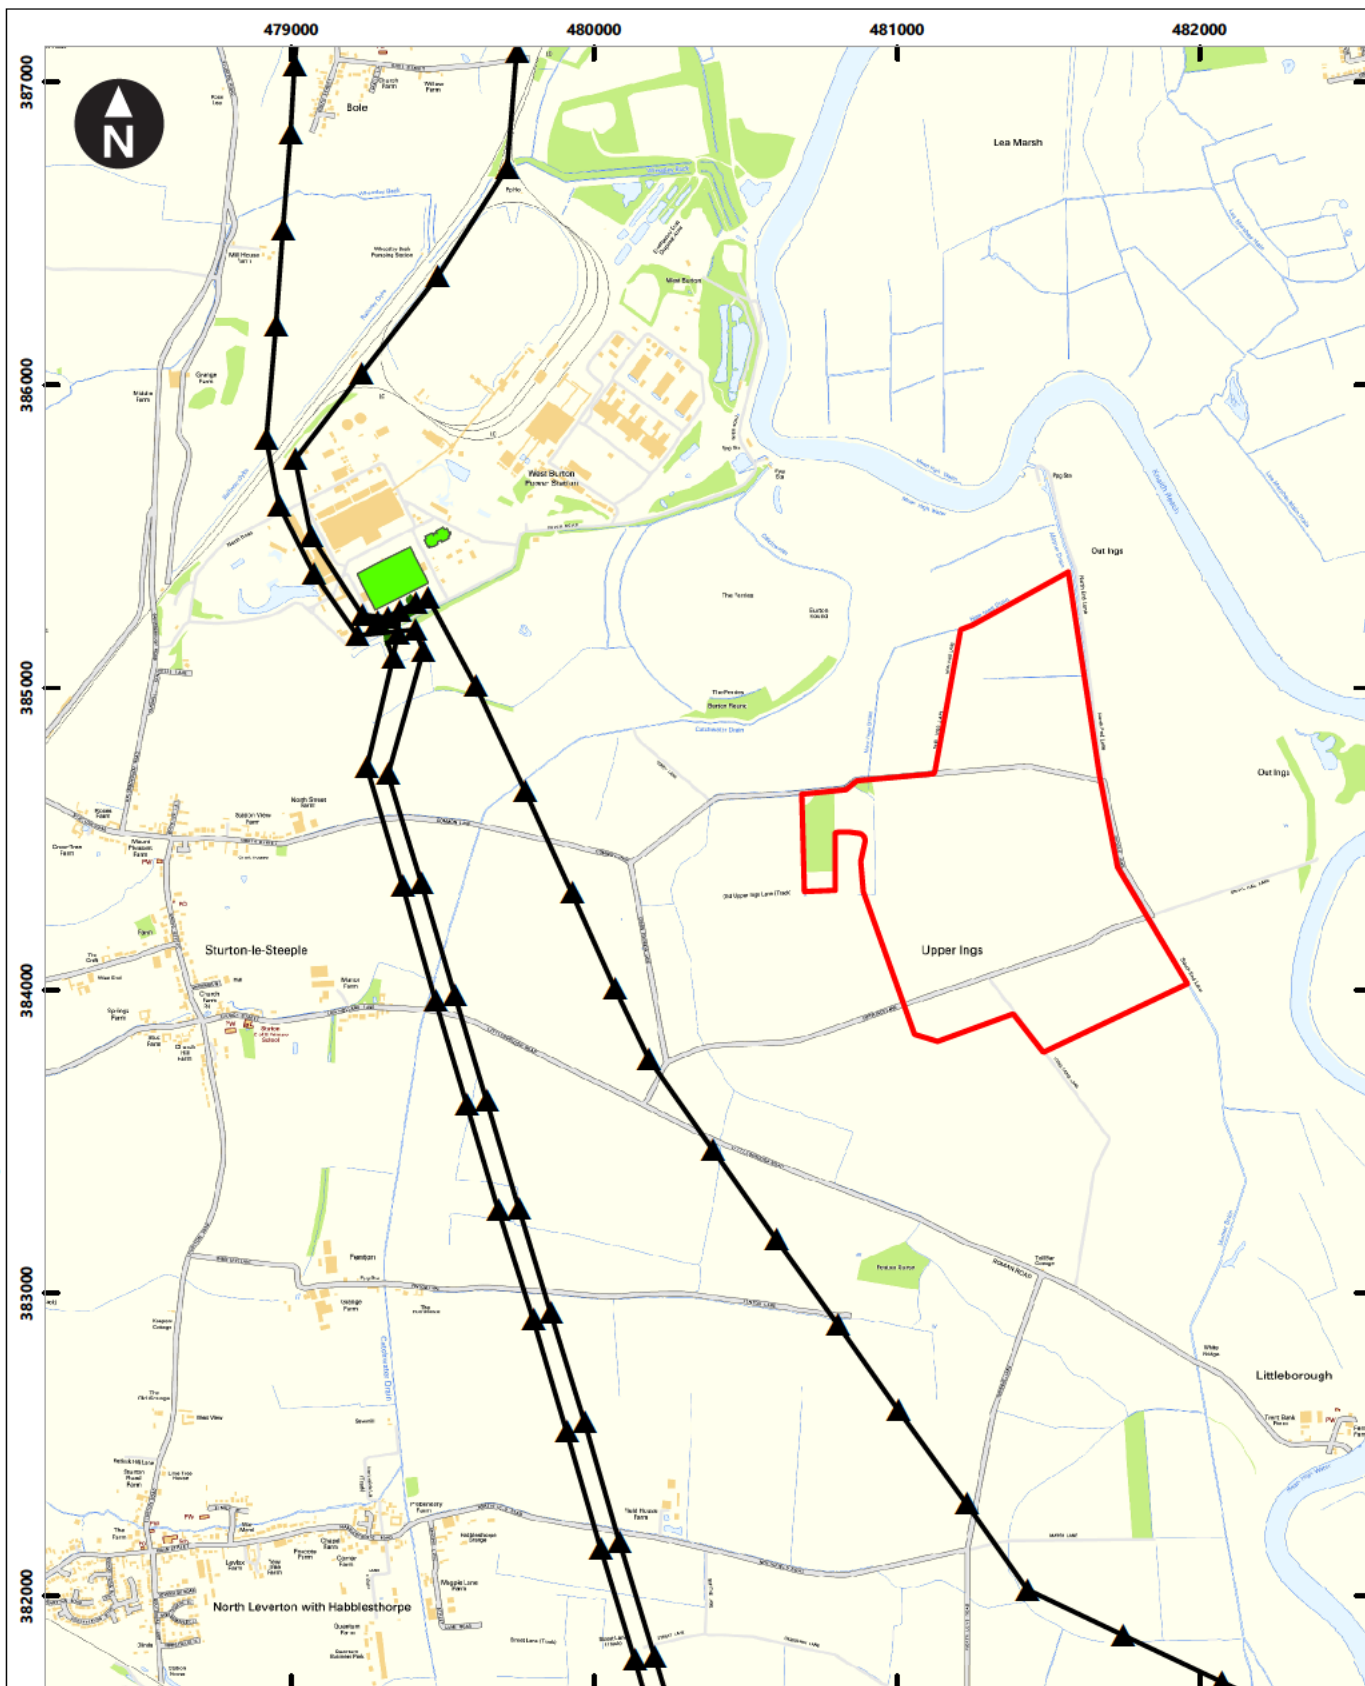

Key

- Indicative site boundary
- Tower
- Overhead line
- Underground Cable
- Substation

0 250 500 750 1,000 m
Scale at A4: 1:25,000


Development Plan Monitoring


National Grid Reference:
Site ET382
MP2c - Sturton le Steeple
Proposed Development Site
Minerals

October 2019



wood.

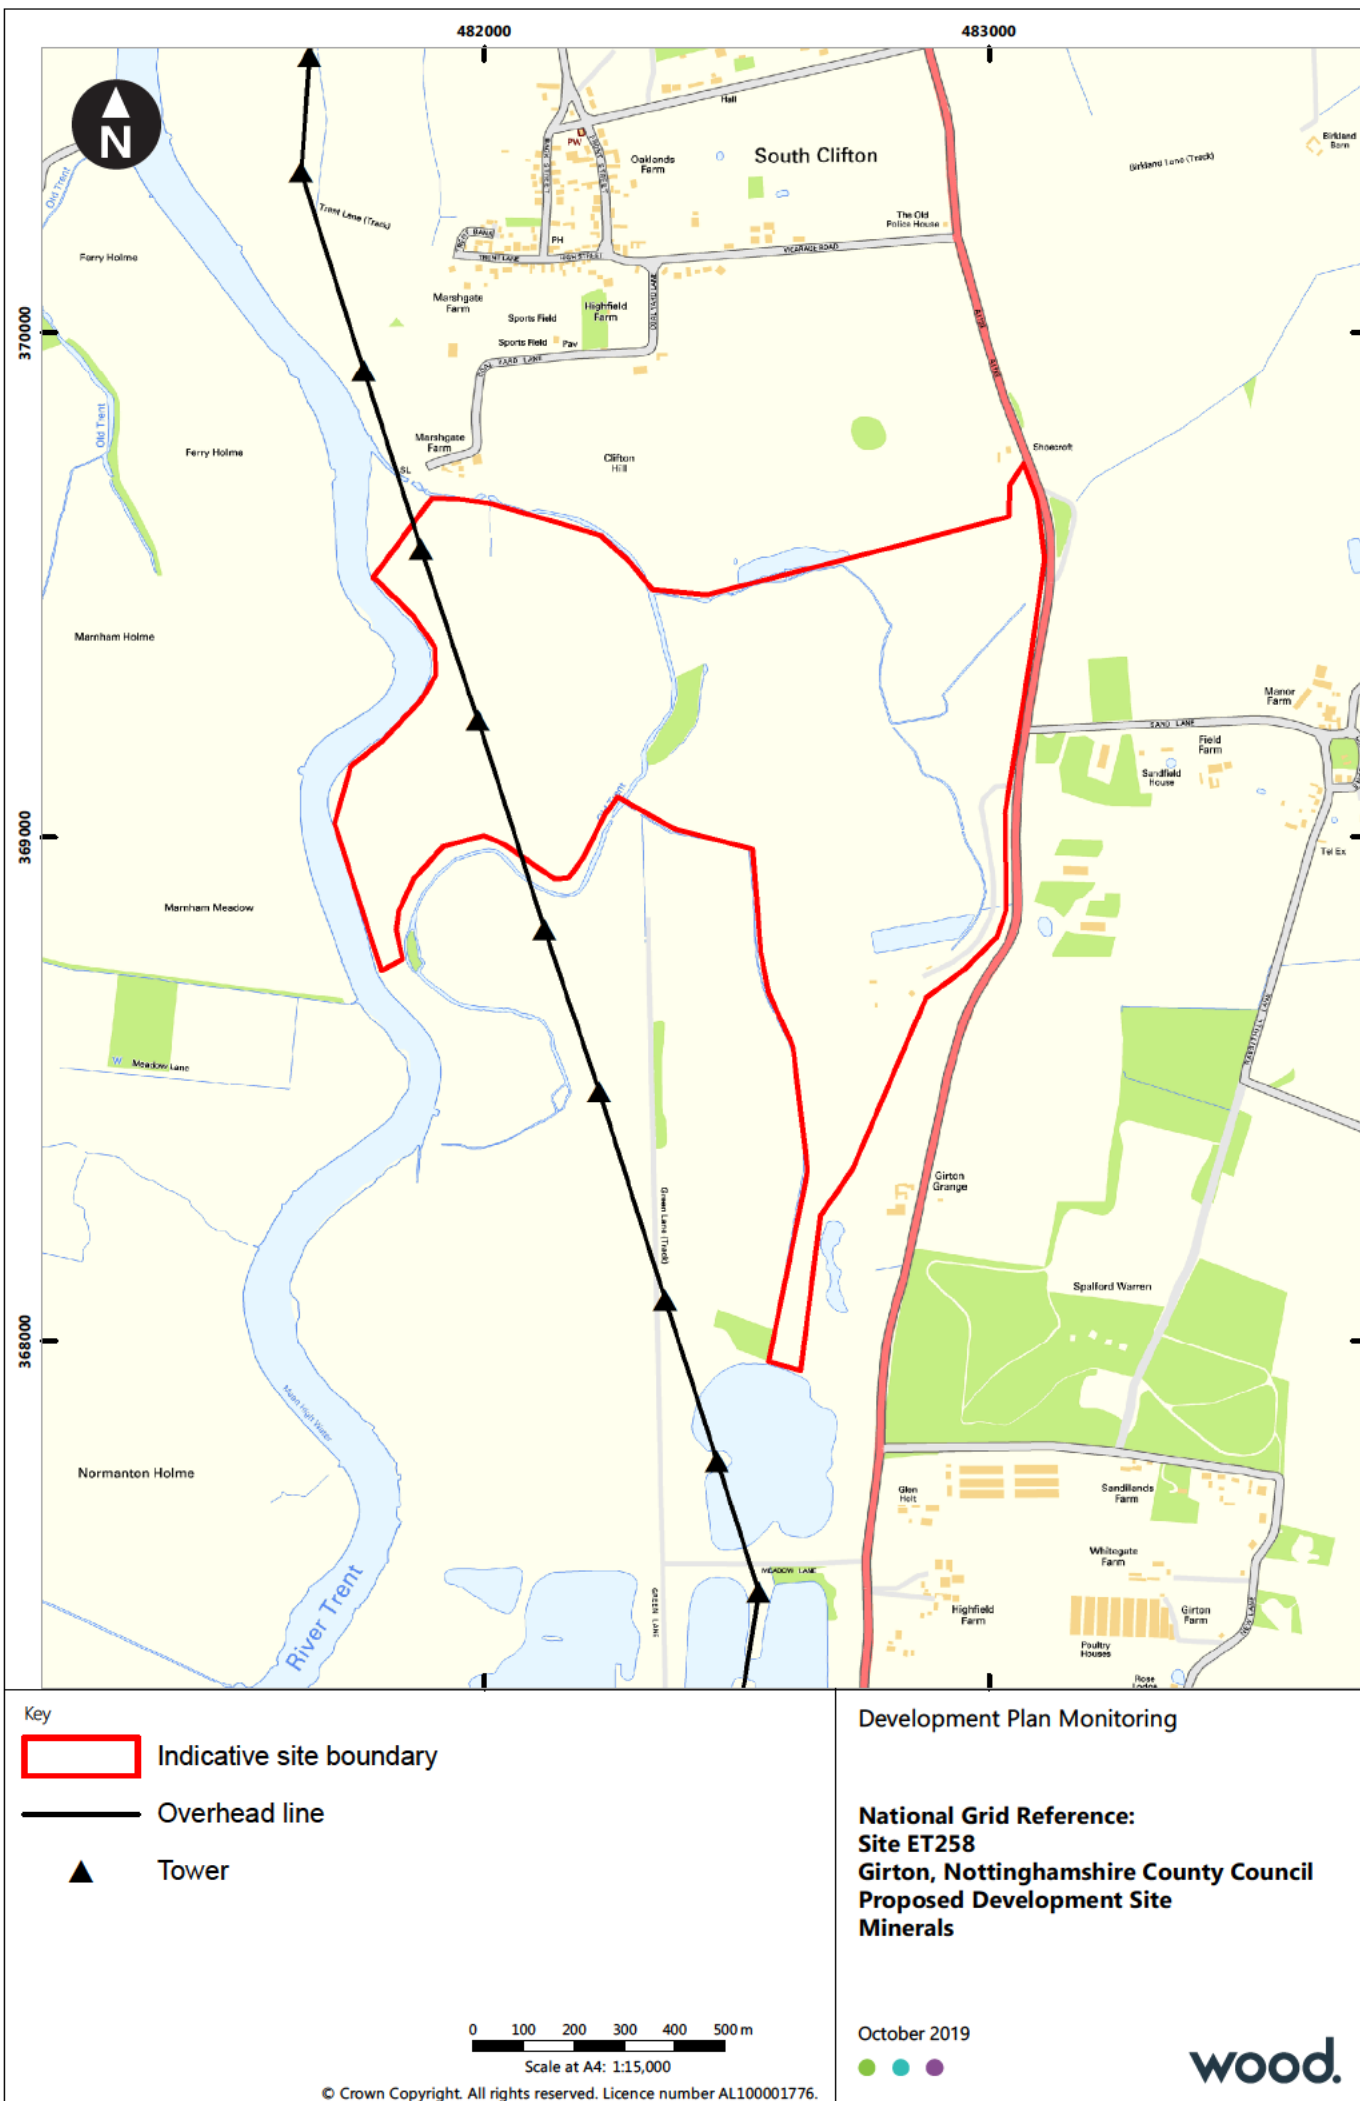

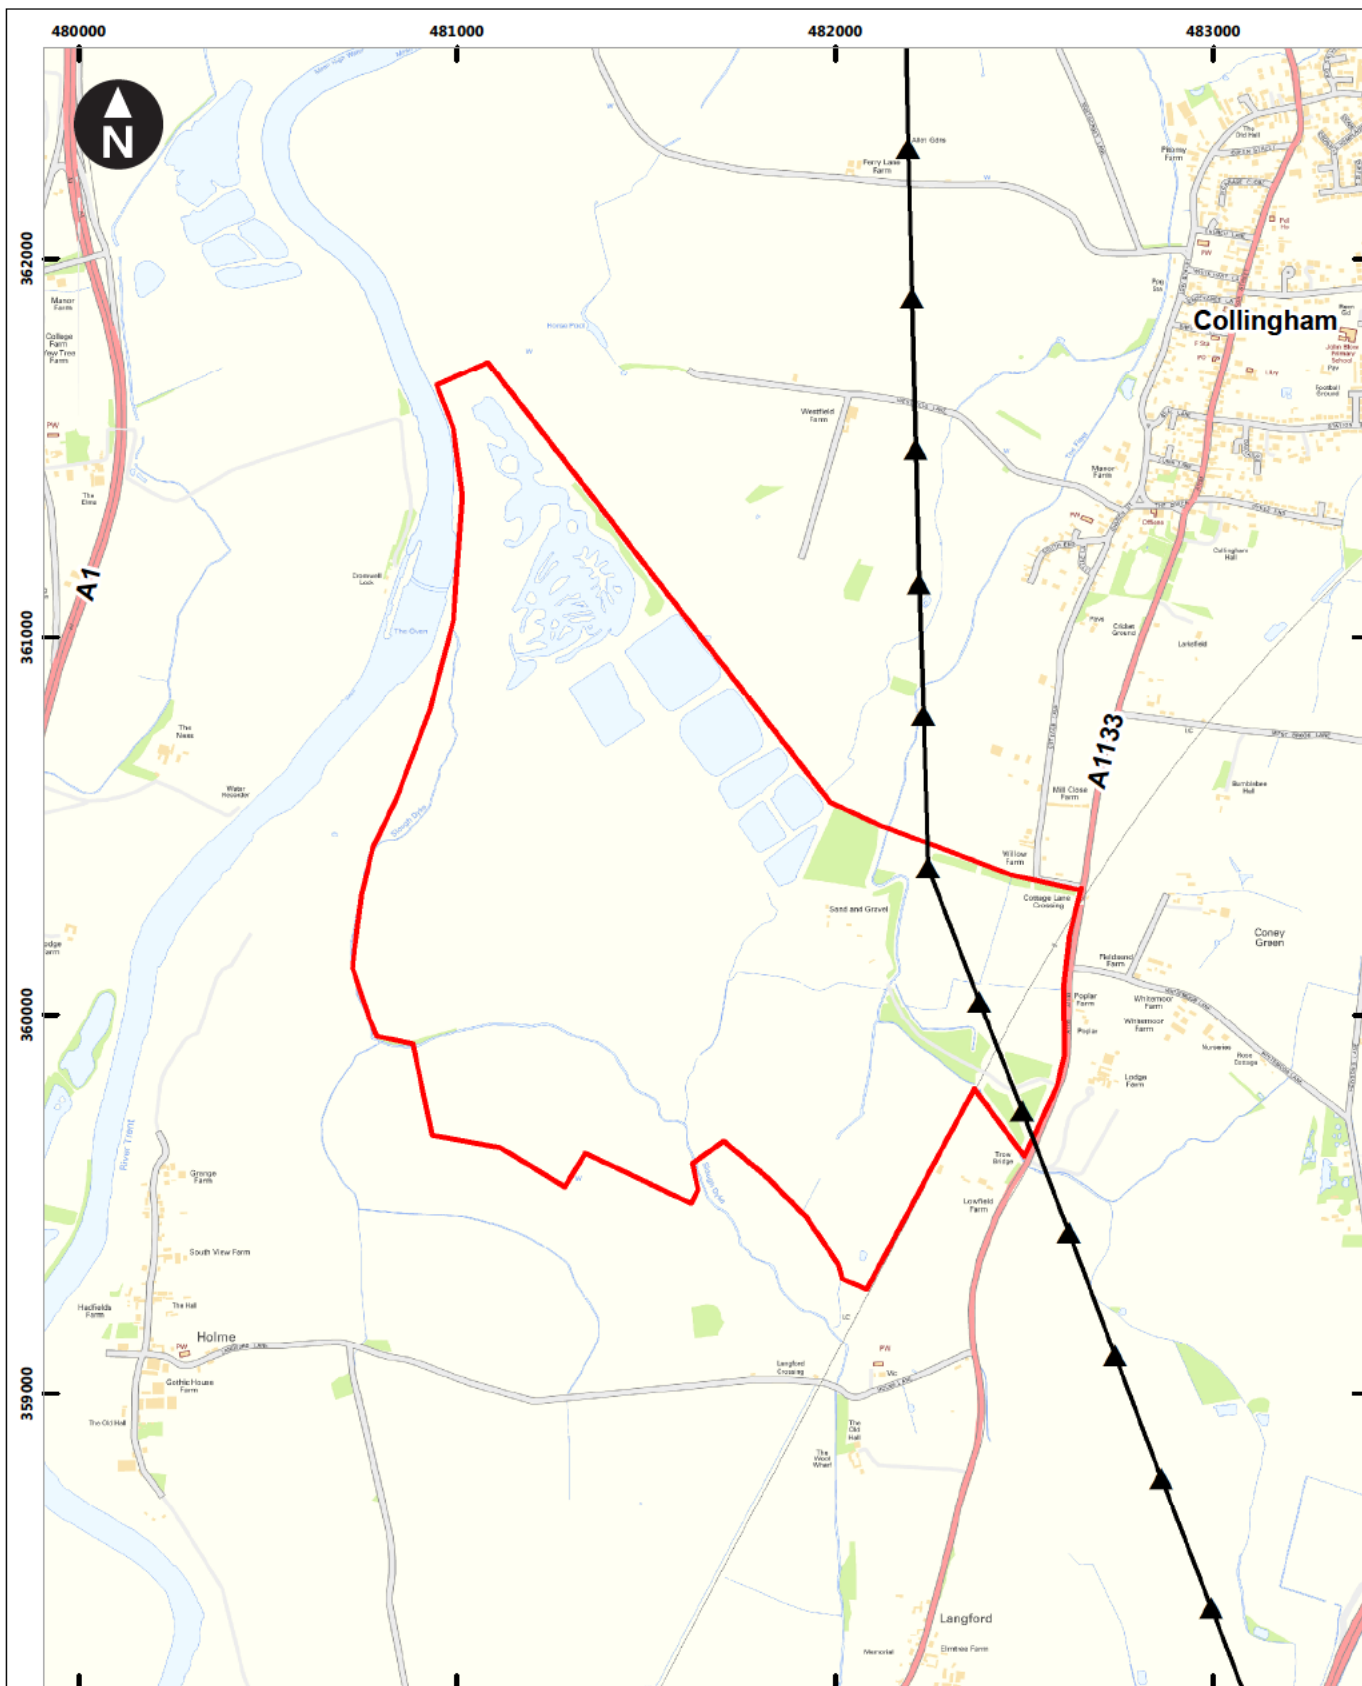

Key

- Indicative site boundary
- Overhead line
- Tower

0 100 200 300 400 500 m

Scale at A4: 1:20,000

© Crown Copyright. All rights reserved. Licence number AL100001776.


Development Plan Monitoring

National Grid Reference:
Site ET259
Langford Lowfields
Nottinghamshire County Council
Proposed Development Site
Minerals

October 2019





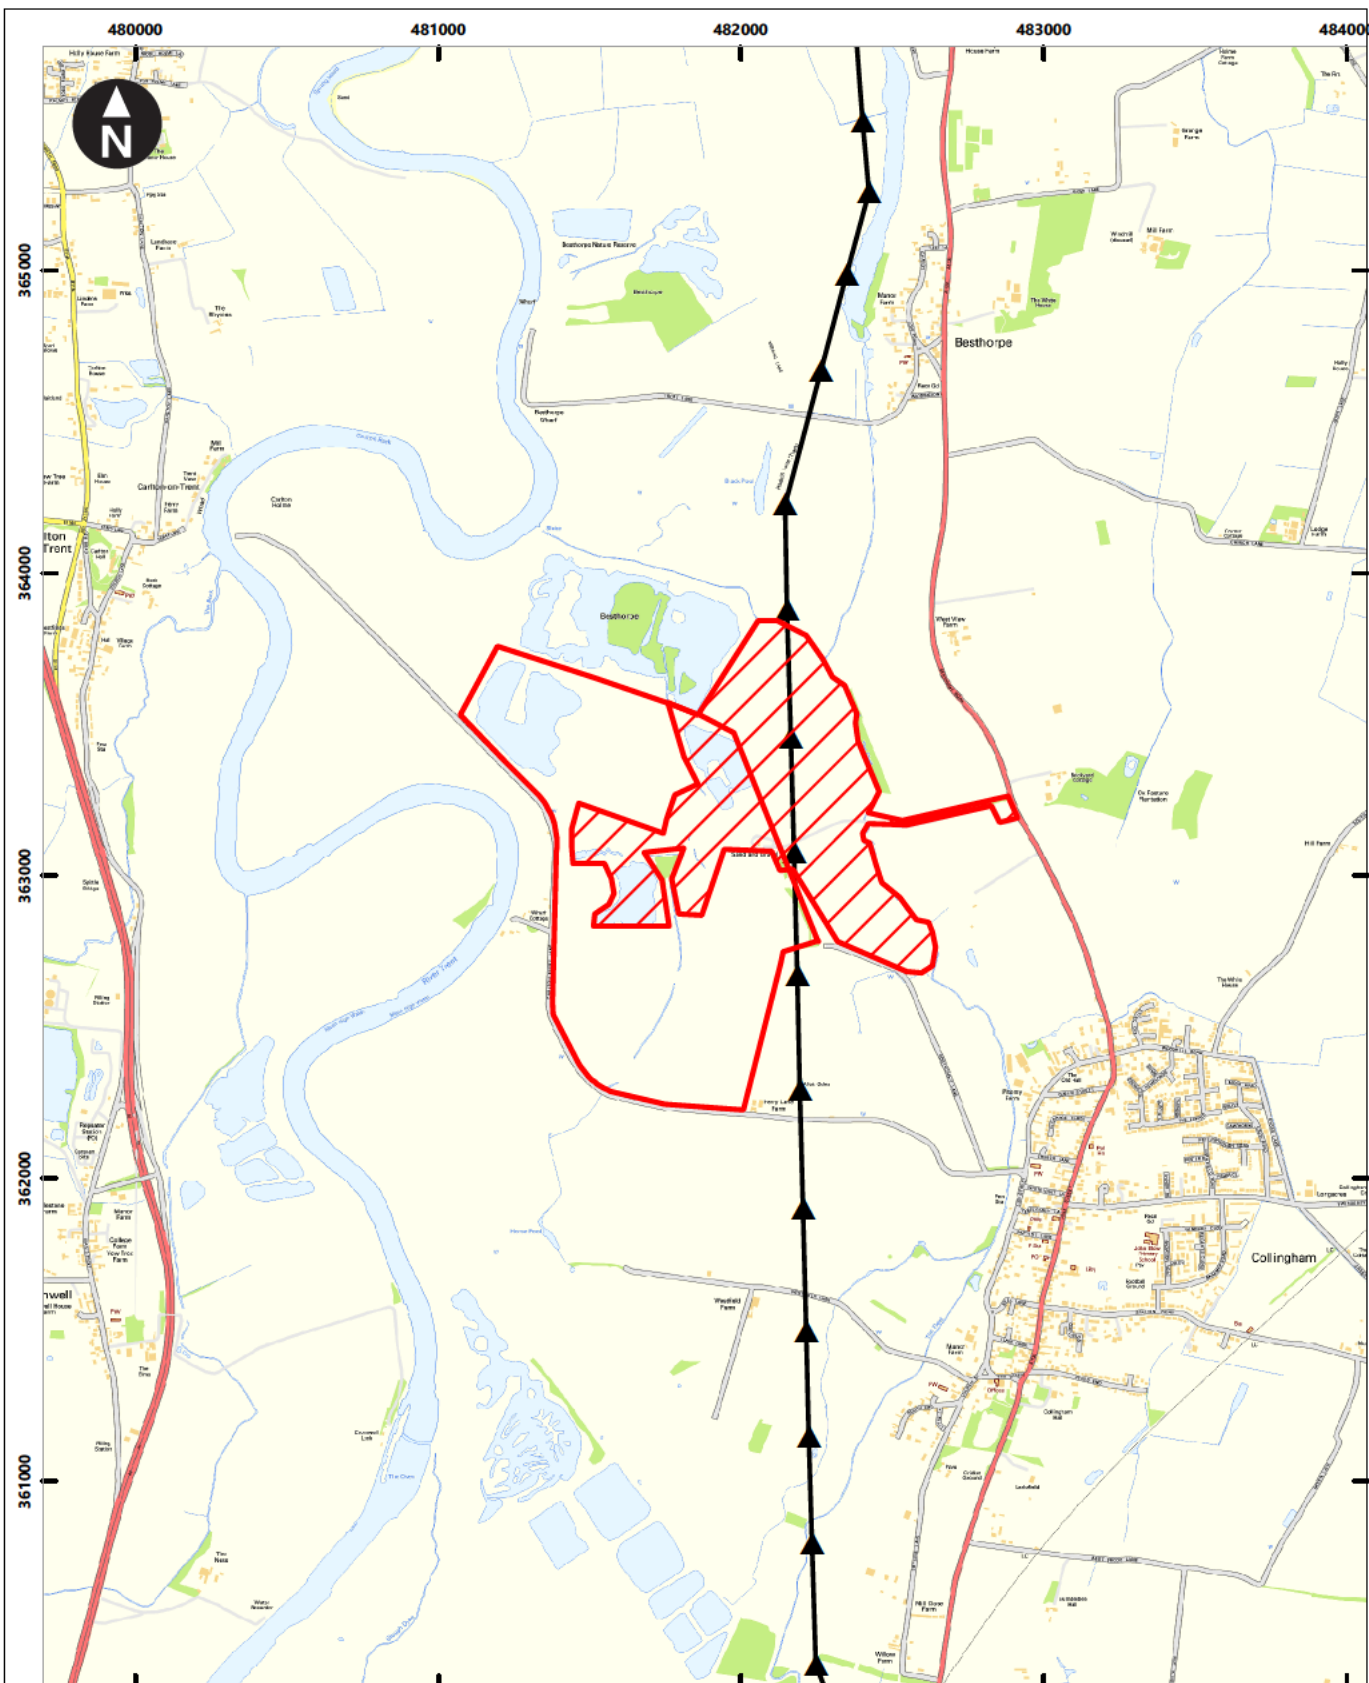

wood.



Key

Name

-  MP2f Besthorpe
-  MP2o Besthorpe East
-  Tower
-  Overhead line

0 250 500 750 1,000 m
Scale at A4: 1:25,000


Development Plan Monitoring

National Grid Reference:
Site ET383
Sites MP2f Besthorpe and MP2o Besthorpe East
Proposed Development Site
Minerals

October 2019



wood.

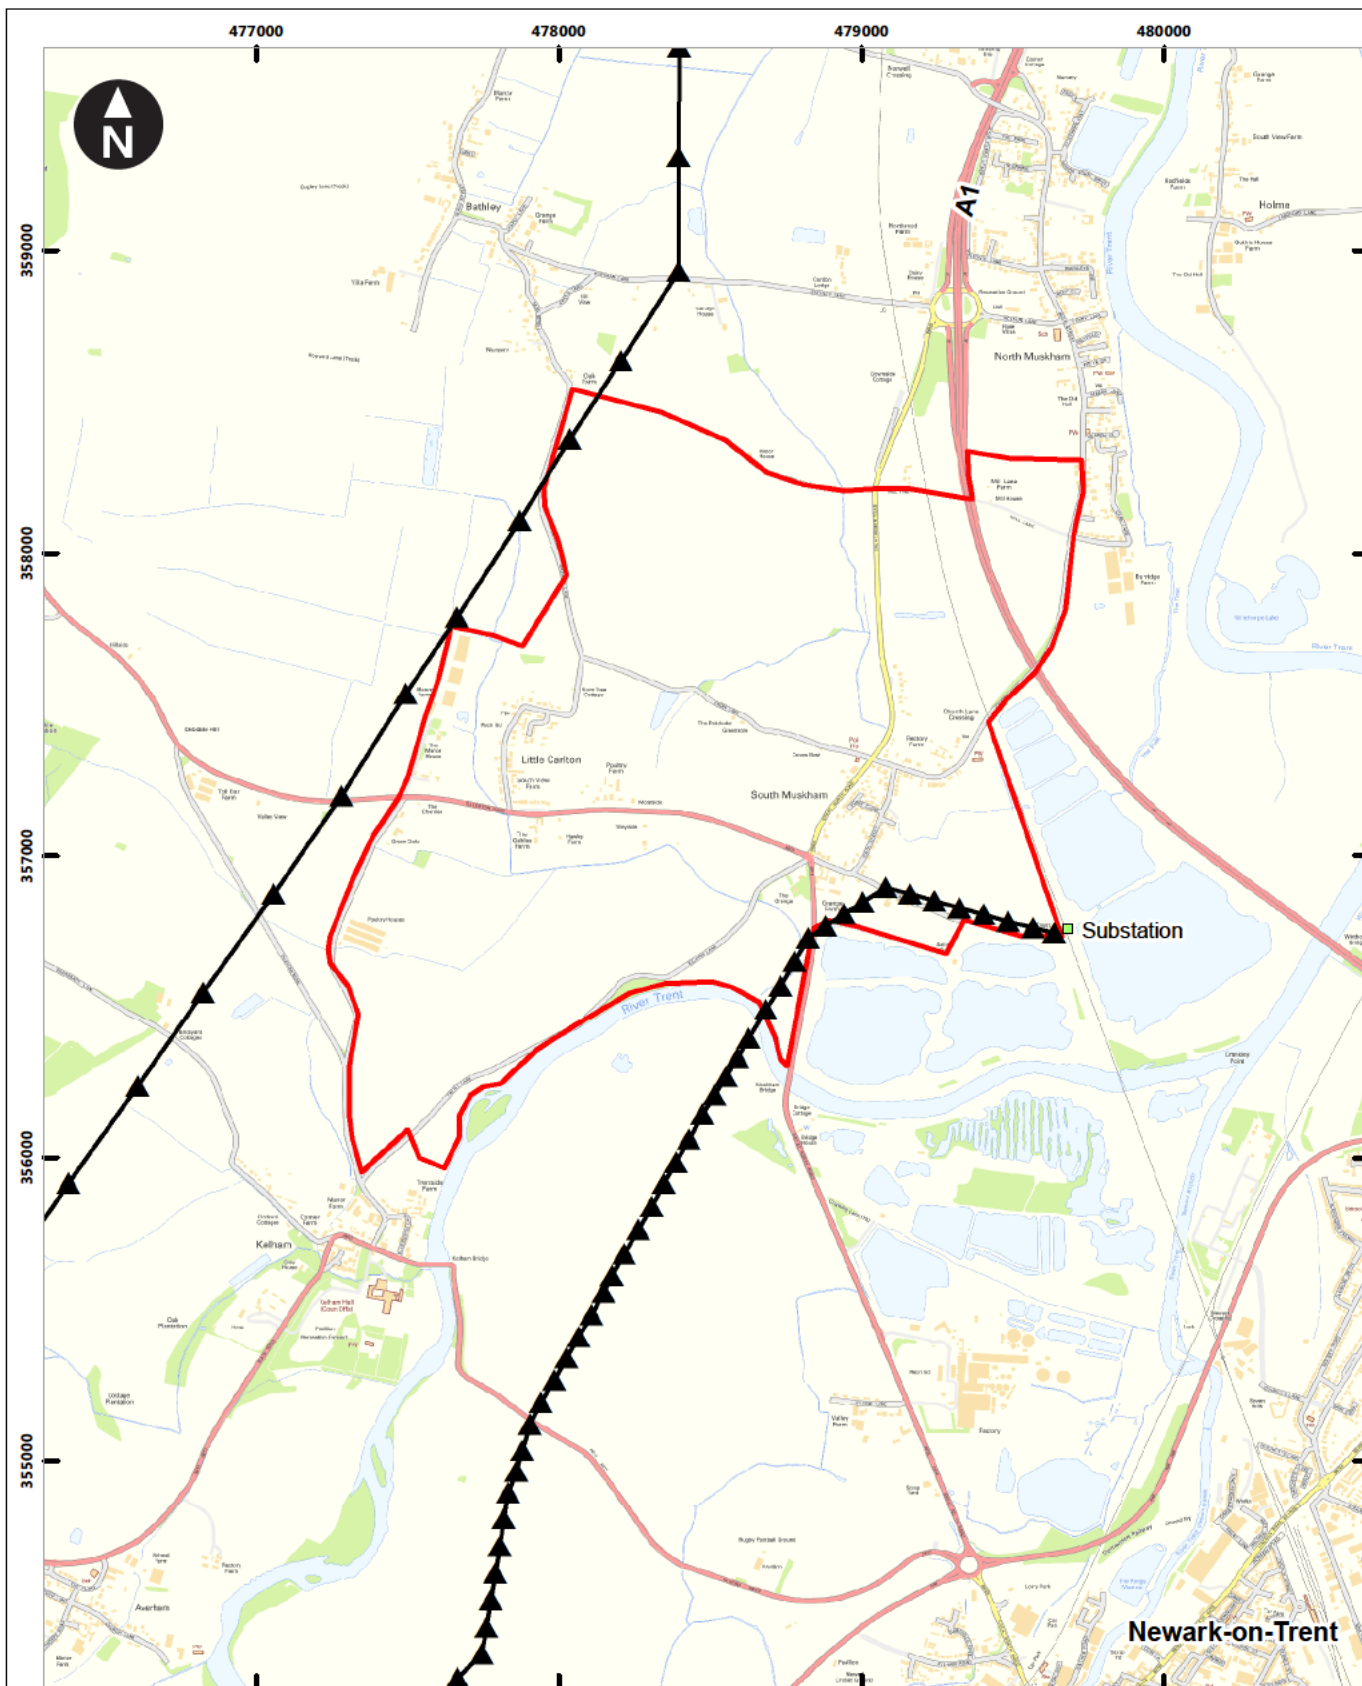

Key

- Indicative site boundary
- Overhead line
- Tower
- Substation

0 250 500 750 1,000 m
Scale at A4: 1:25,000

© Crown Copyright. All rights reserved. Licence number AL100001776.


Development Plan Monitoring

National Grid Reference:
Site ET260
South Muskham (DM6),
Nottinghamshire County Council
Proposed Development Site
Minerals

October 2019



wood.

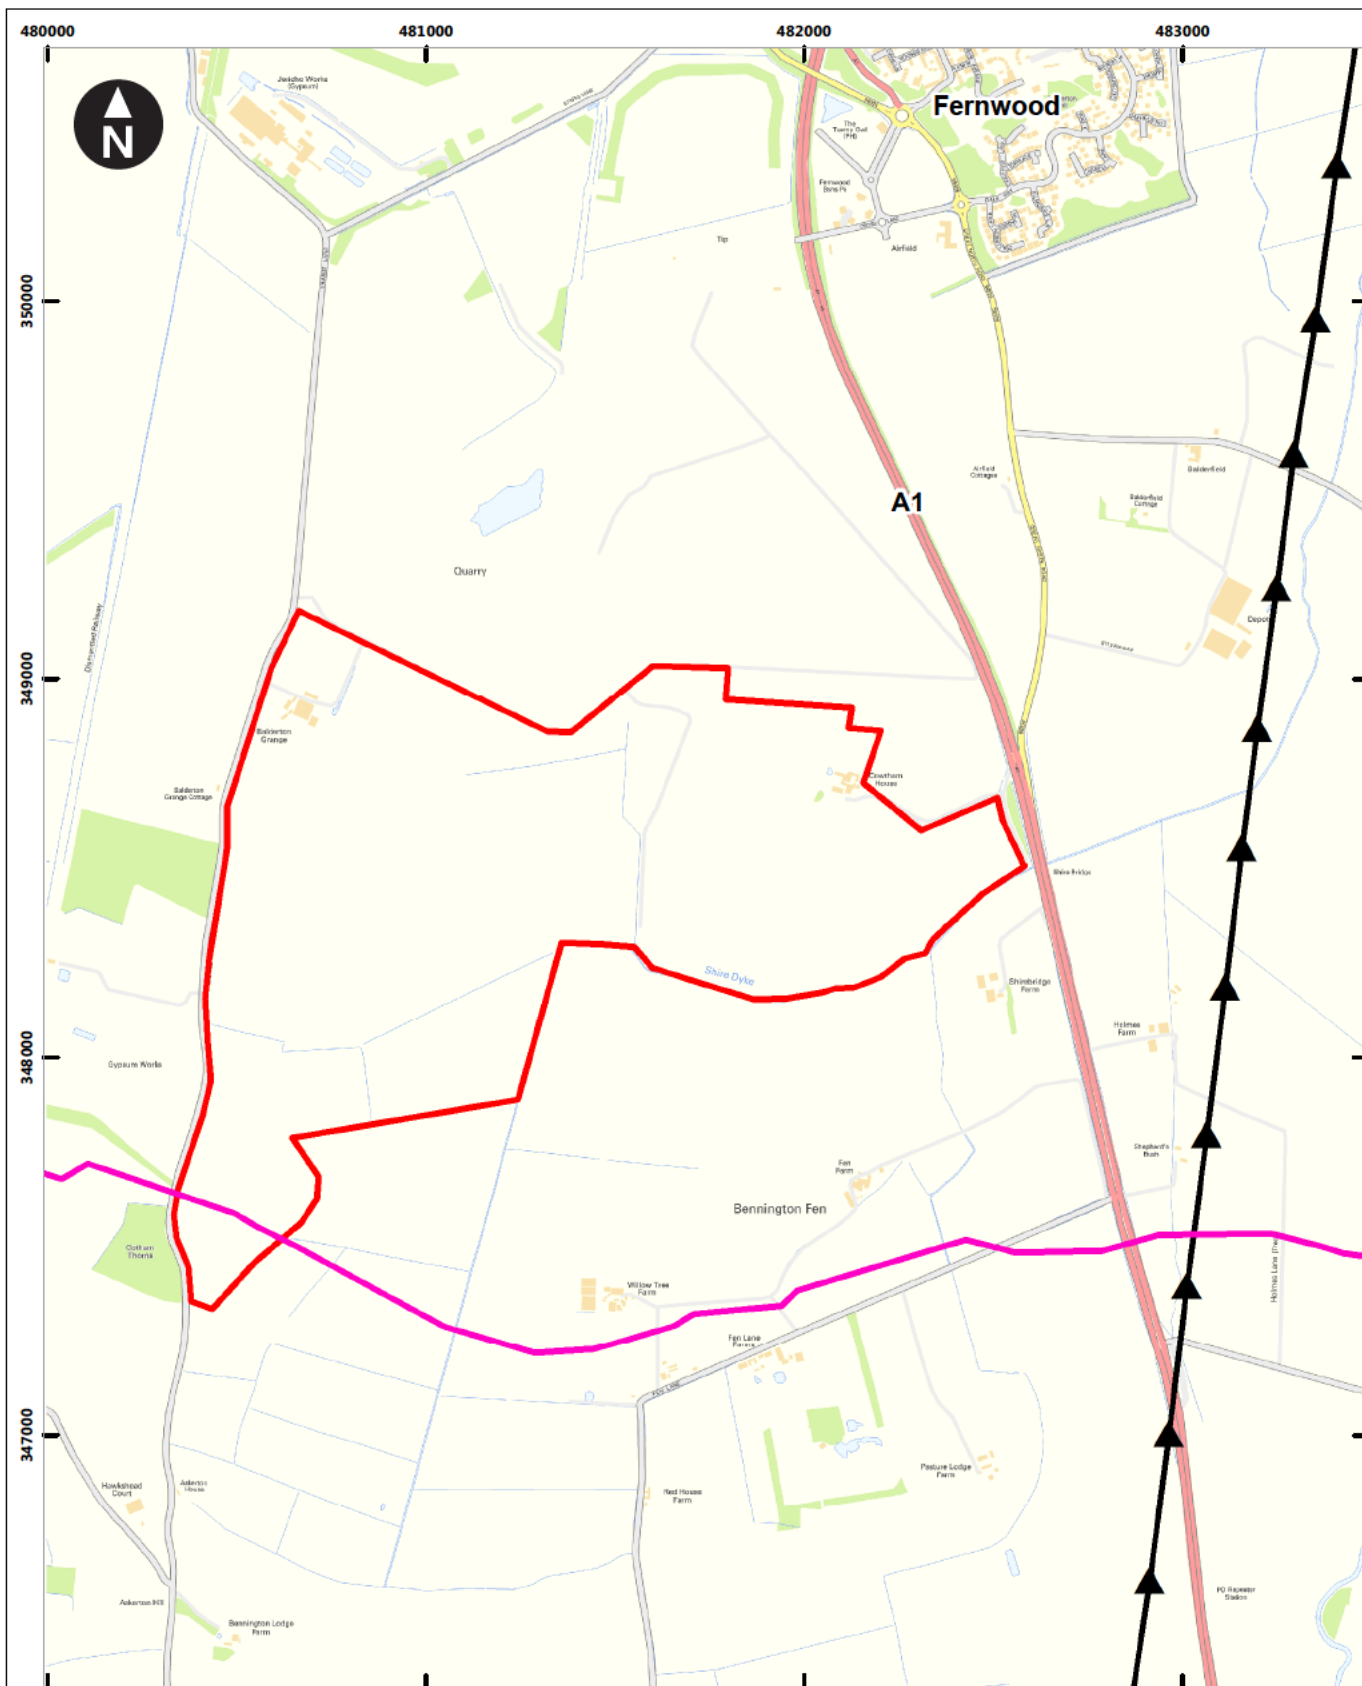

Key

- Indicative site boundary
- Overhead line
- Tower
- Gas transmission pipeline (high pressure)

0 250 500 750 1,000 m
Scale at A4: 1:20,000

© Crown Copyright. All rights reserved. Licence number AL100001776.

Development Plan Monitoring

National Grid Reference:
Site GT87
Bantycok Quarry South (MP7c),
Nottinghamshire County Council
Proposed Development Site
Minerals

October 2019



wood.