


NOTES:

1. If distance 'x' is greater than or equal to 1000mm then the remainder of ditch should be backfilled with acceptable material and compacted in accordance with Tables 6/1 & 6/4.
2. If distance 'x' is less than 1000mm, the remainder of ditch to be backfilled with capping material Type 1 sub-base upto sub-formation or formation respectively.
3. The 6B1 starter layer shall be crushed rock complying with the requirements of The Specification of Highway Works for a class 6B and with the grading below.

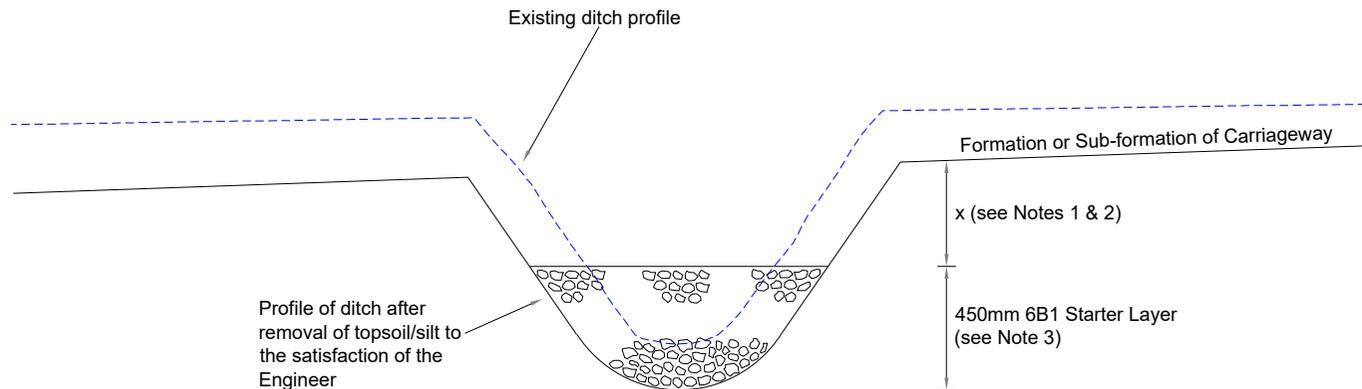

CLASS	PERCENTAGE BY MASS PASSING THE SIZE SHOWN						
	SIZE (mm)						
	150	125	100	50	10	2	0.063
6B1	100		0 - 20				0 - 5

Rev.	Description	Drawn	Ch'kd	Auth	Date



in partnership with



www.viaem.co.uk Tel 0115 804 2100

Bilsthorpe Depot, Bilsthorpe Business Park, Bilsthorpe, Nottinghamshire, NG22 8ST

Project		Highway Construction Details			Project	Drawn	Date
Status	Project No.	DRAINAGE			Ch'kd	JLS	12/06/2020
Drawing Title		Treatment of Diverted Ditches Under New Carriageways			Auth	JJP	29/06/20
Drawing No.		SD/5/33a			Rev.	0	Traced JLS Scale N.T.S @A4