


NOTES:

1. All dimensions are in millimetres unless otherwise stated.
2. Drain trenches are to be dug to the specified depth in true lines and gradients with a width of 600mm.
3. The trench shall be backfilled with Type D filter material which shall be hard, clean, crushed rock excluding such materials containing ironstone, limestone or other calcium rich materials to the grading given below:-

BS SIEVE SIZE	PERCENTAGE PASSING
75mm	100
63mm	85 - 100
50mm	0 - 10
37.5mm	0 - 5

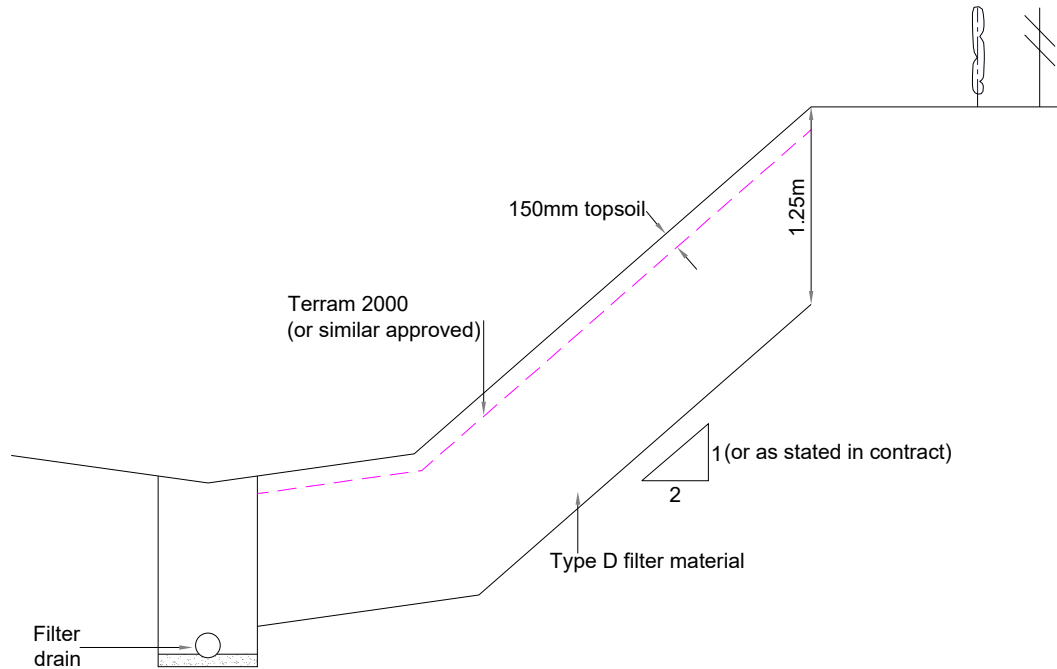

Rev.	Description	Drawn	Ch'kd	Auth	Date



in partnership with



www.viaem.co.uk Tel 0115 804 2100

Bilsthorpe Depot, Bilsthorpe Business Park, Bilsthorpe, Nottinghamshire, NG22 8ST

Project		Highway Construction Details			Project	Drawn	JLS	Date	12/06/2020
Status	Project No.	DRAINAGE			Ch'kd	JD	Date	29/06/20	
Drawing Title		Batter Drains			Auth	JJP	Traced	JLS	
Drawing No.		SD/5/36			Rev.	0	Scale	N.T.S @A4	