



STAGE 1

Install ramp profile edgings at the 4 corners of the proposed table (6 ramp units on a T-junction table) in accordance with Drg No SD/7/19

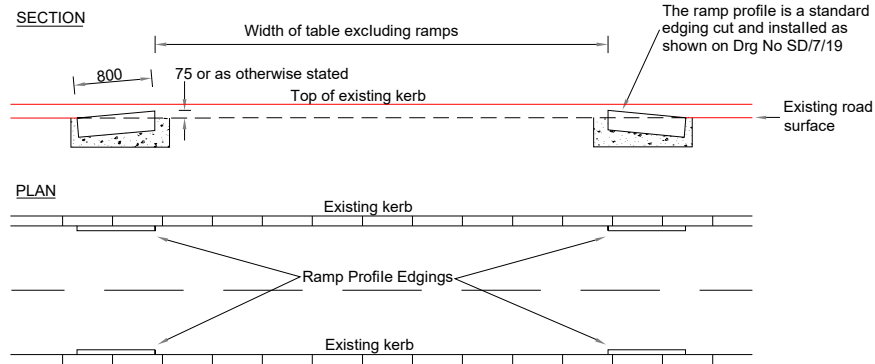


STAGE 2

Cut chases 500mm wide 50mm deep across the carriageway as shown (see Note 3 regarding temporary ramping)

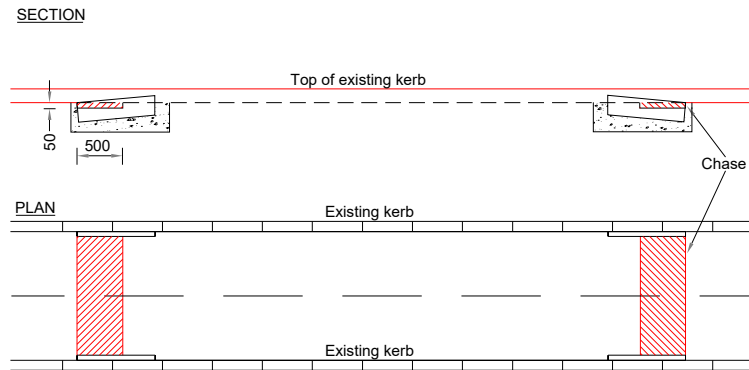


STAGE 3

Lay first layer of asphalt 40mm thick



STAGE 4

Lay the second layer of asphalt and form ramps. On cambered roads, a temporary steel shoe as per Drg No SD/7/18 should be placed on the crown of the road to ensure the gradient is maintained across the width of the road. The temporary shoes should be removed when one half of the road has been rolled.



NOTES:

1. All dimensions are in millimetres unless otherwise stated.
2. Tables to be constructed in 55%/10mm medium temperature asphalt to BS594 col 3/4 unless otherwise agreed.
3. The Contractor is responsible for maintaining temporary ramps whilst open to the traffic.
4. The ends of the ramp profiles should be protected by suitable traffic management and temporary ramping for Stages 1, 2 and 3.
5. The Contractor must phase his works to ensure surfacing materials are to the appropriate temperatures or alternatively hot-box storage bins used to ensure temperatures are in accordance with the specification.
6. Drawing to be read in conjunction with Drg Nos SD/7/18 and SD/7/19.

Rev.	Description	Drawn	Ch'kd	Auth	Date

in partnership with
Nottinghamshire County Council
 www.viaem.co.uk Tel 0115 804 2100
 Bilsthorpe Depot, Bilsthorpe Business Park, Bilsthorpe,
 Nottinghamshire, NG22 8ST

Project		Highway Construction Details			Project	Drawn	Date
Status	Project No.	Kerbs and Footways			JLS	18/08/2020	
Drawing Title		Construction Of Kerb To Kerb Speed Tables & Junction Tables			Ch'kd	Date	
Drawing No.		SD/7/17			JDP	12/02/2021	
					Auth	Traced	JLS
					Rev.	Scale	N.T.S @A4
					0		

Feb 12, 2021 - 11:51am I:\Highways\Design and Construction\Roads and Highways\Projects\18-19\2020020971 New Hwy Design Guide for New Dev\Design\CAD\New standard details\NCC-SDX-Sections\SD/7/17.dwg