


NOTES:

1. All dimensions are in millimetres unless otherwise stated.
2. Ducts to be sealed with expanding foam following successful testing of the cable network.
3. Dimensions of pillar to suit the size of the consumer unit, cable reduction terminals etc plus a 25% extra capacity.
4. Pillar to be fitted with three phase 12 way distribution board, 63A triple pole and neutral isolator and 12 No BS 88 fuse carriers.



Rev.	Description	Drawn	Ch'kd	Auth	Date
		JLS			13/08/2020
		JD			04/02/2021
		JP		JLS	
		0		N.T.S @A4	

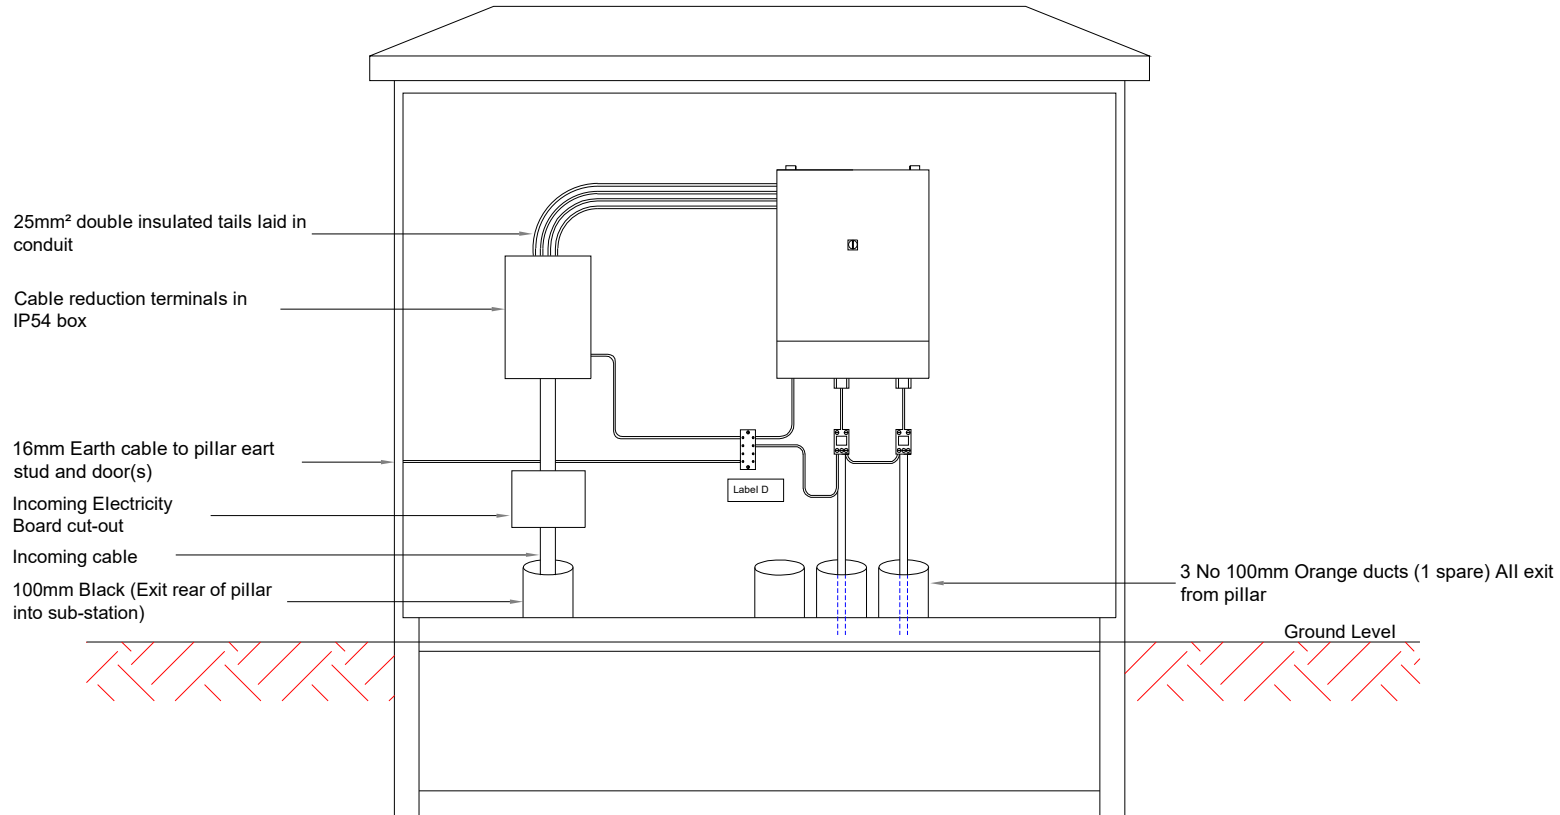

in partnership with



**Nottinghamshire  
County Council**

www.viaem.co.uk Tel 0115 804 2100

Bilthorpe Depot, Bilthorpe Business Park, Bilthorpe,  
Nottinghamshire, NG22 8ST

Project	Highway Construction Details				Date	13/08/2020		
Status	Project No.	Street Lighting		Ch'kd	JD	Date	04/02/2021	
Drawing Title	Three Phase Feeder Pillar Layout With 12 Out-going Ways				Auth	JP	Traced	JLS
Drawing No.	SD/14/06				Rev.	0	Scale	N.T.S @A4