




PLAN VIEW

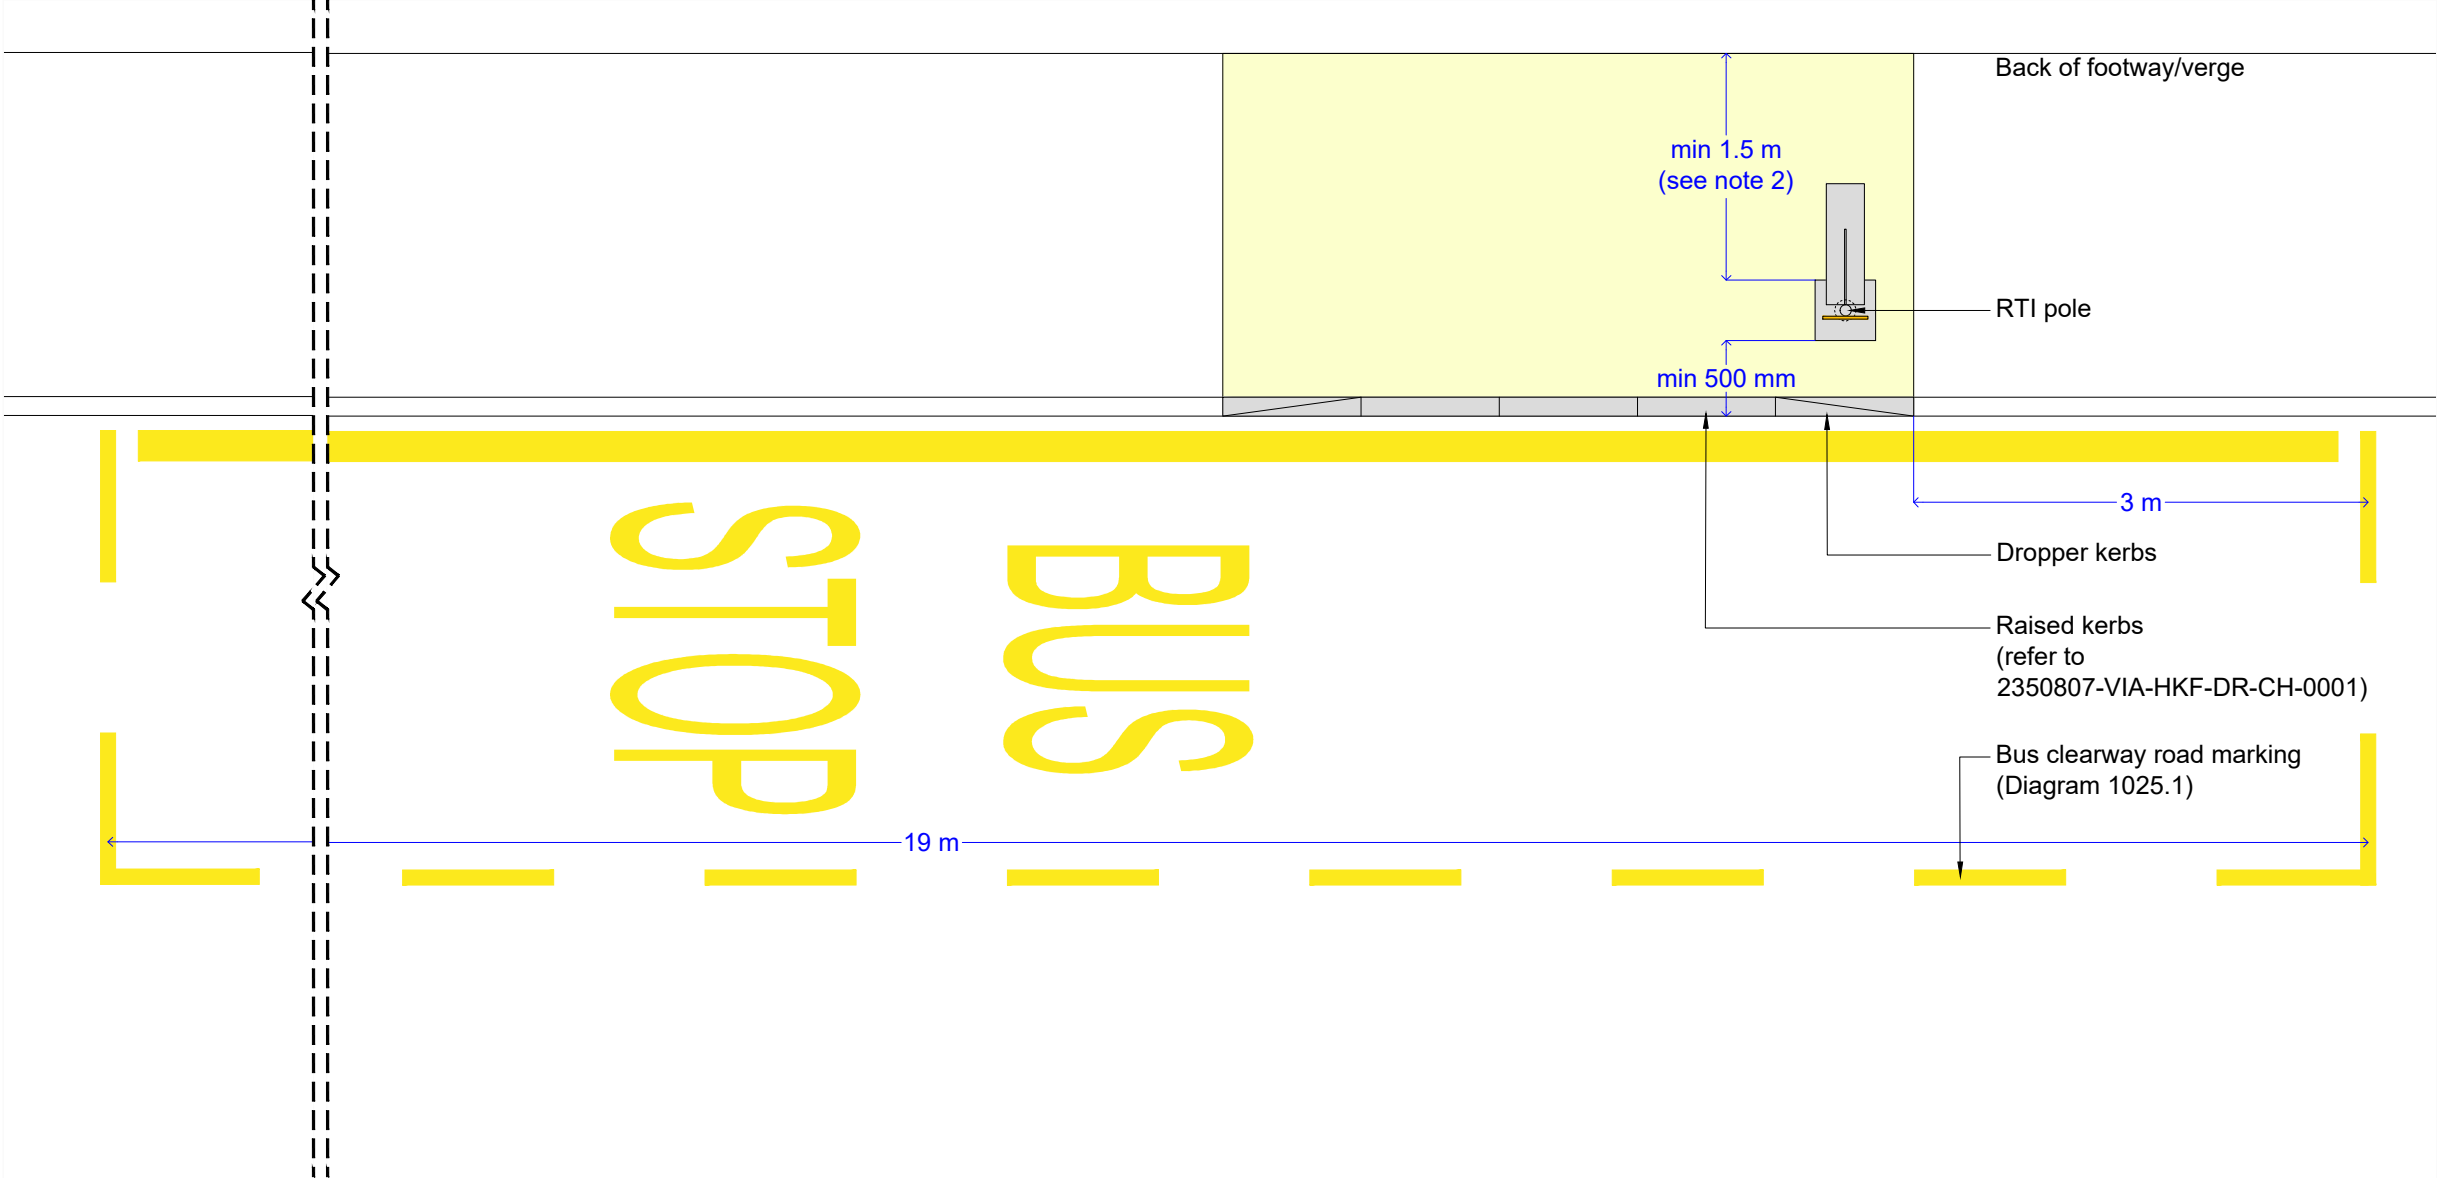

LONG SECTION

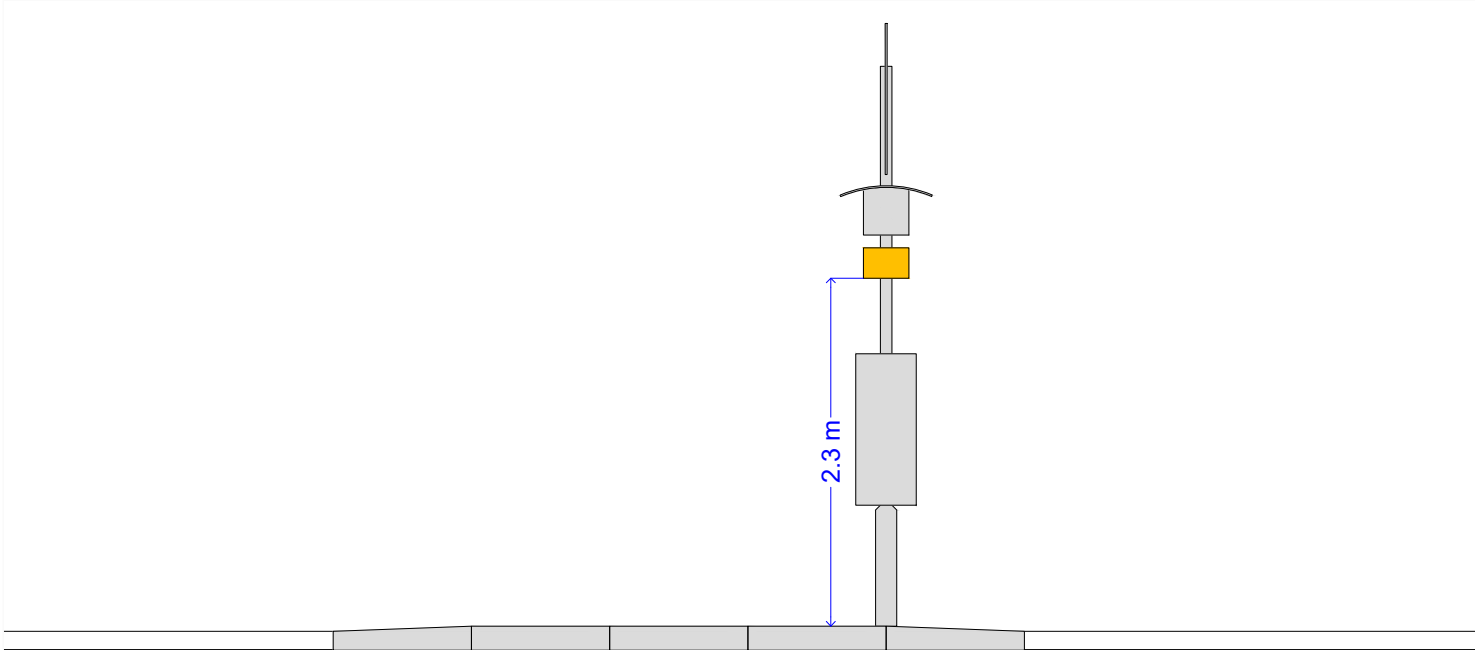

CROSS SECTION

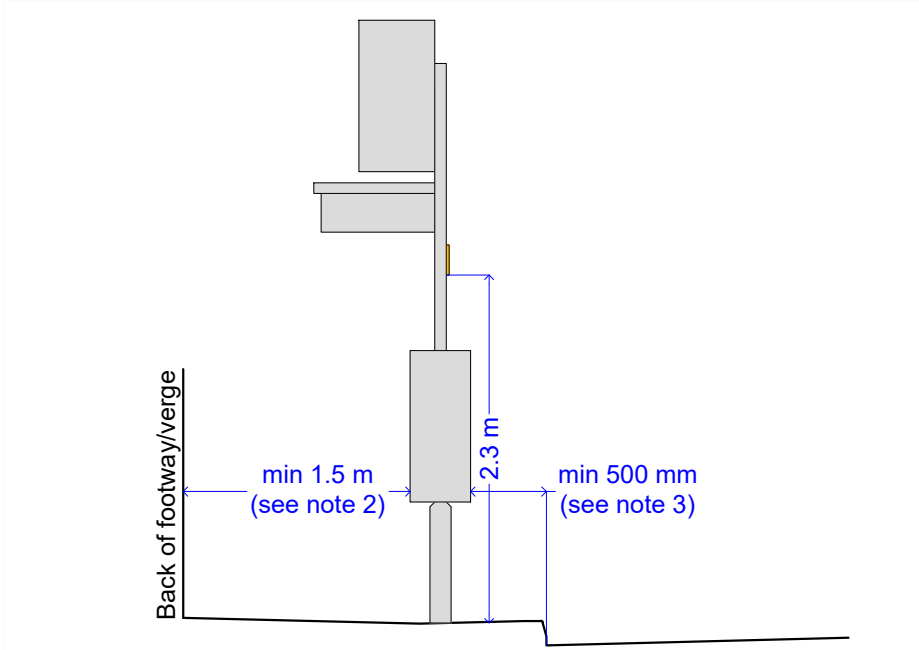



NOTES

1. This drawing is to be read in conjunction with all other relevant drawings, details and specifications.
2. Required minimum footway width is 1.5 m (to be measured from timetable case); occasionally this can be reduced to 1.2 m (to be agreed with TTS). If bus stop is installed on existing shared footway/cycleway, minimum footway width to be 3 m.
3. RTI pole must be installed at min 500 mm offset from carriageway (to be measured from timetable case).
4. For electrical connection of RTI display refer to ESD 6/33.
5. Refer to 2350807-VIA-HGN-IS-CH-0001 for more details.

SIGN DETAIL



Sign to TSRGS S4-3-2

A	Notes revised	BC	DC	DC	05/24
Rev.	Description	Drawn	Ch'kd	Auth	Date
Project					
Bus Stop Configuration					
Status	Project No. TP2350807				
Drawing Title					
Alternative Configuration without Shelter					
Scale 1:50 @A3	Drawn BC		Date 02/02/24		
	Ch'kd DC		Date 07/03/24		
	Auth DC		Traced		BC
Drawing No. 2350807-VIA-HGN-DR-CH-0010					Rev. A
<div><div></div><div><div>in partnership with</div><div></div></div></div> <div>www.viaem.co.uk Tel 0115 804 2100 Bilsthorpe Depot, Bilsthorpe Business Park, Bilsthorpe, Nottinghamshire, NG22 6ST</div>					